


ALARMS TO BAS

HIGH PRESSURE

120 V SUPPLY POWER

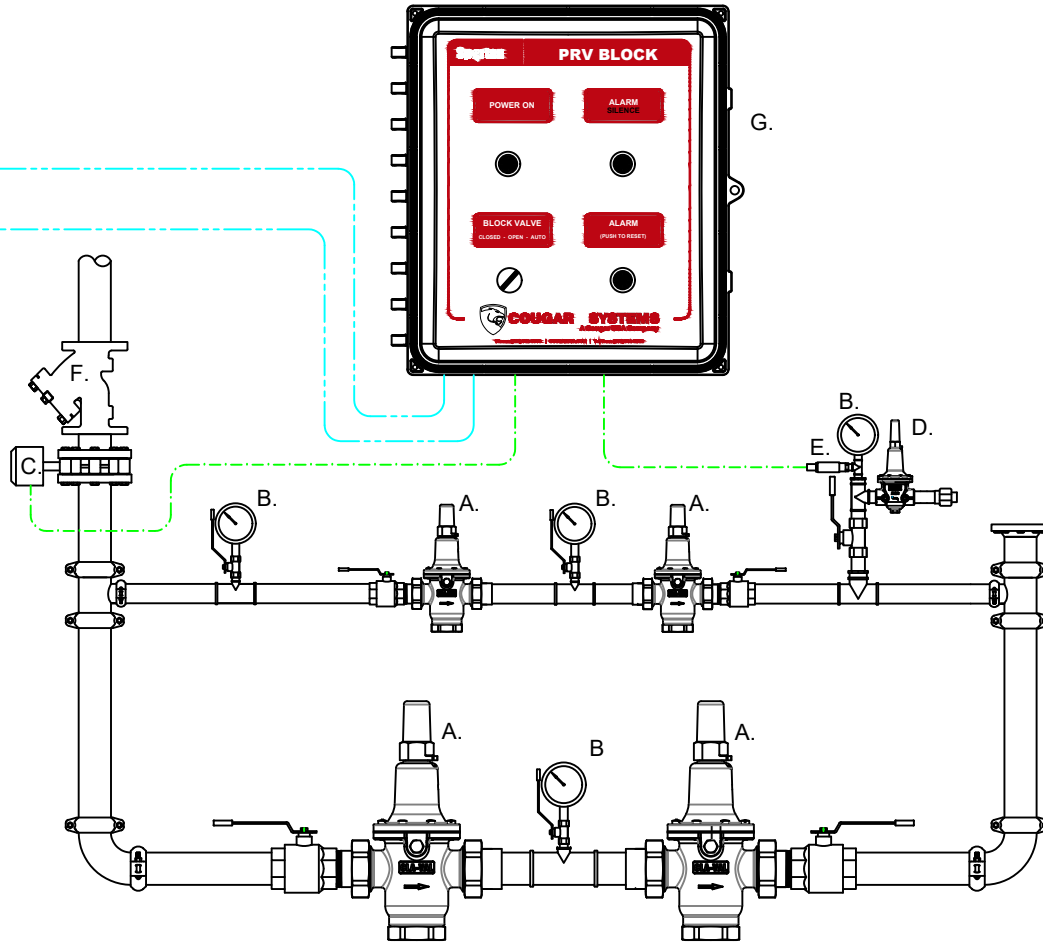

BLUE INDICATES "COORDINATE WITH OTHER DISCIPLINES"

INDICATES FIELD WIRING BY SYSTEM SUPPLIER

ALL RELATED LOCAL CONTROL WIRE & CONDUIT BY SYSTEM SUPPLIER TO ENSURE A COMPLETE, COORDINATED AND FUNCTIONAL SYSTEM

COMPONENT LEGEND

- A. PRV, CLA-VAL MODEL CRD-L, SEE DRAWINGS FOR SIZE
- B. PRESSURE GAUGE
- C. BLOCK VALVE, ACTUATED BY CONTROL PANEL
- D. RELIEF VALVE, CLA-VAL 55B-60
- E. MECHANICAL PRESSURE SWITCH, PROSENSE MPS25 SERIES
- F. KECKLEY LOW LEAD Y- STRAINER
- G. COUGAR SYSTEMS SPARTAN SERIES CONTROL PANEL



Engineering Contact:
Michael Balboni
Direct: (713) 253-2320
Email: mbalboni@cougarusa.com

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF COUGAR SALES, INC. AND SHALL NOT BE REPRODUCED WITHOUT WRITTEN PERMISSION. THIS DOCUMENT IS ISSUED SOLELY AS A REFERENCE FILE. THIS DOCUMENT SHALL NOT BE USED FOR PERMITTING, BIDDING, OR CONSTRUCTION PURPOSES.

PRV Station Direct Acting
In Series High Flow - Low Flow

Sheet No.

P-1

ISSUE FOR ENGINEER APPROVAL / SUBMITTAL

C:\Users\Nimona\AppData\Local\Temp\AcfPublish_23810A.PRV_Station_Direct_Acting_In_Series_High_Flow - Low_Flow.dwg - Tuesday, February 26, 2020 - 11:05 AM - Inverts